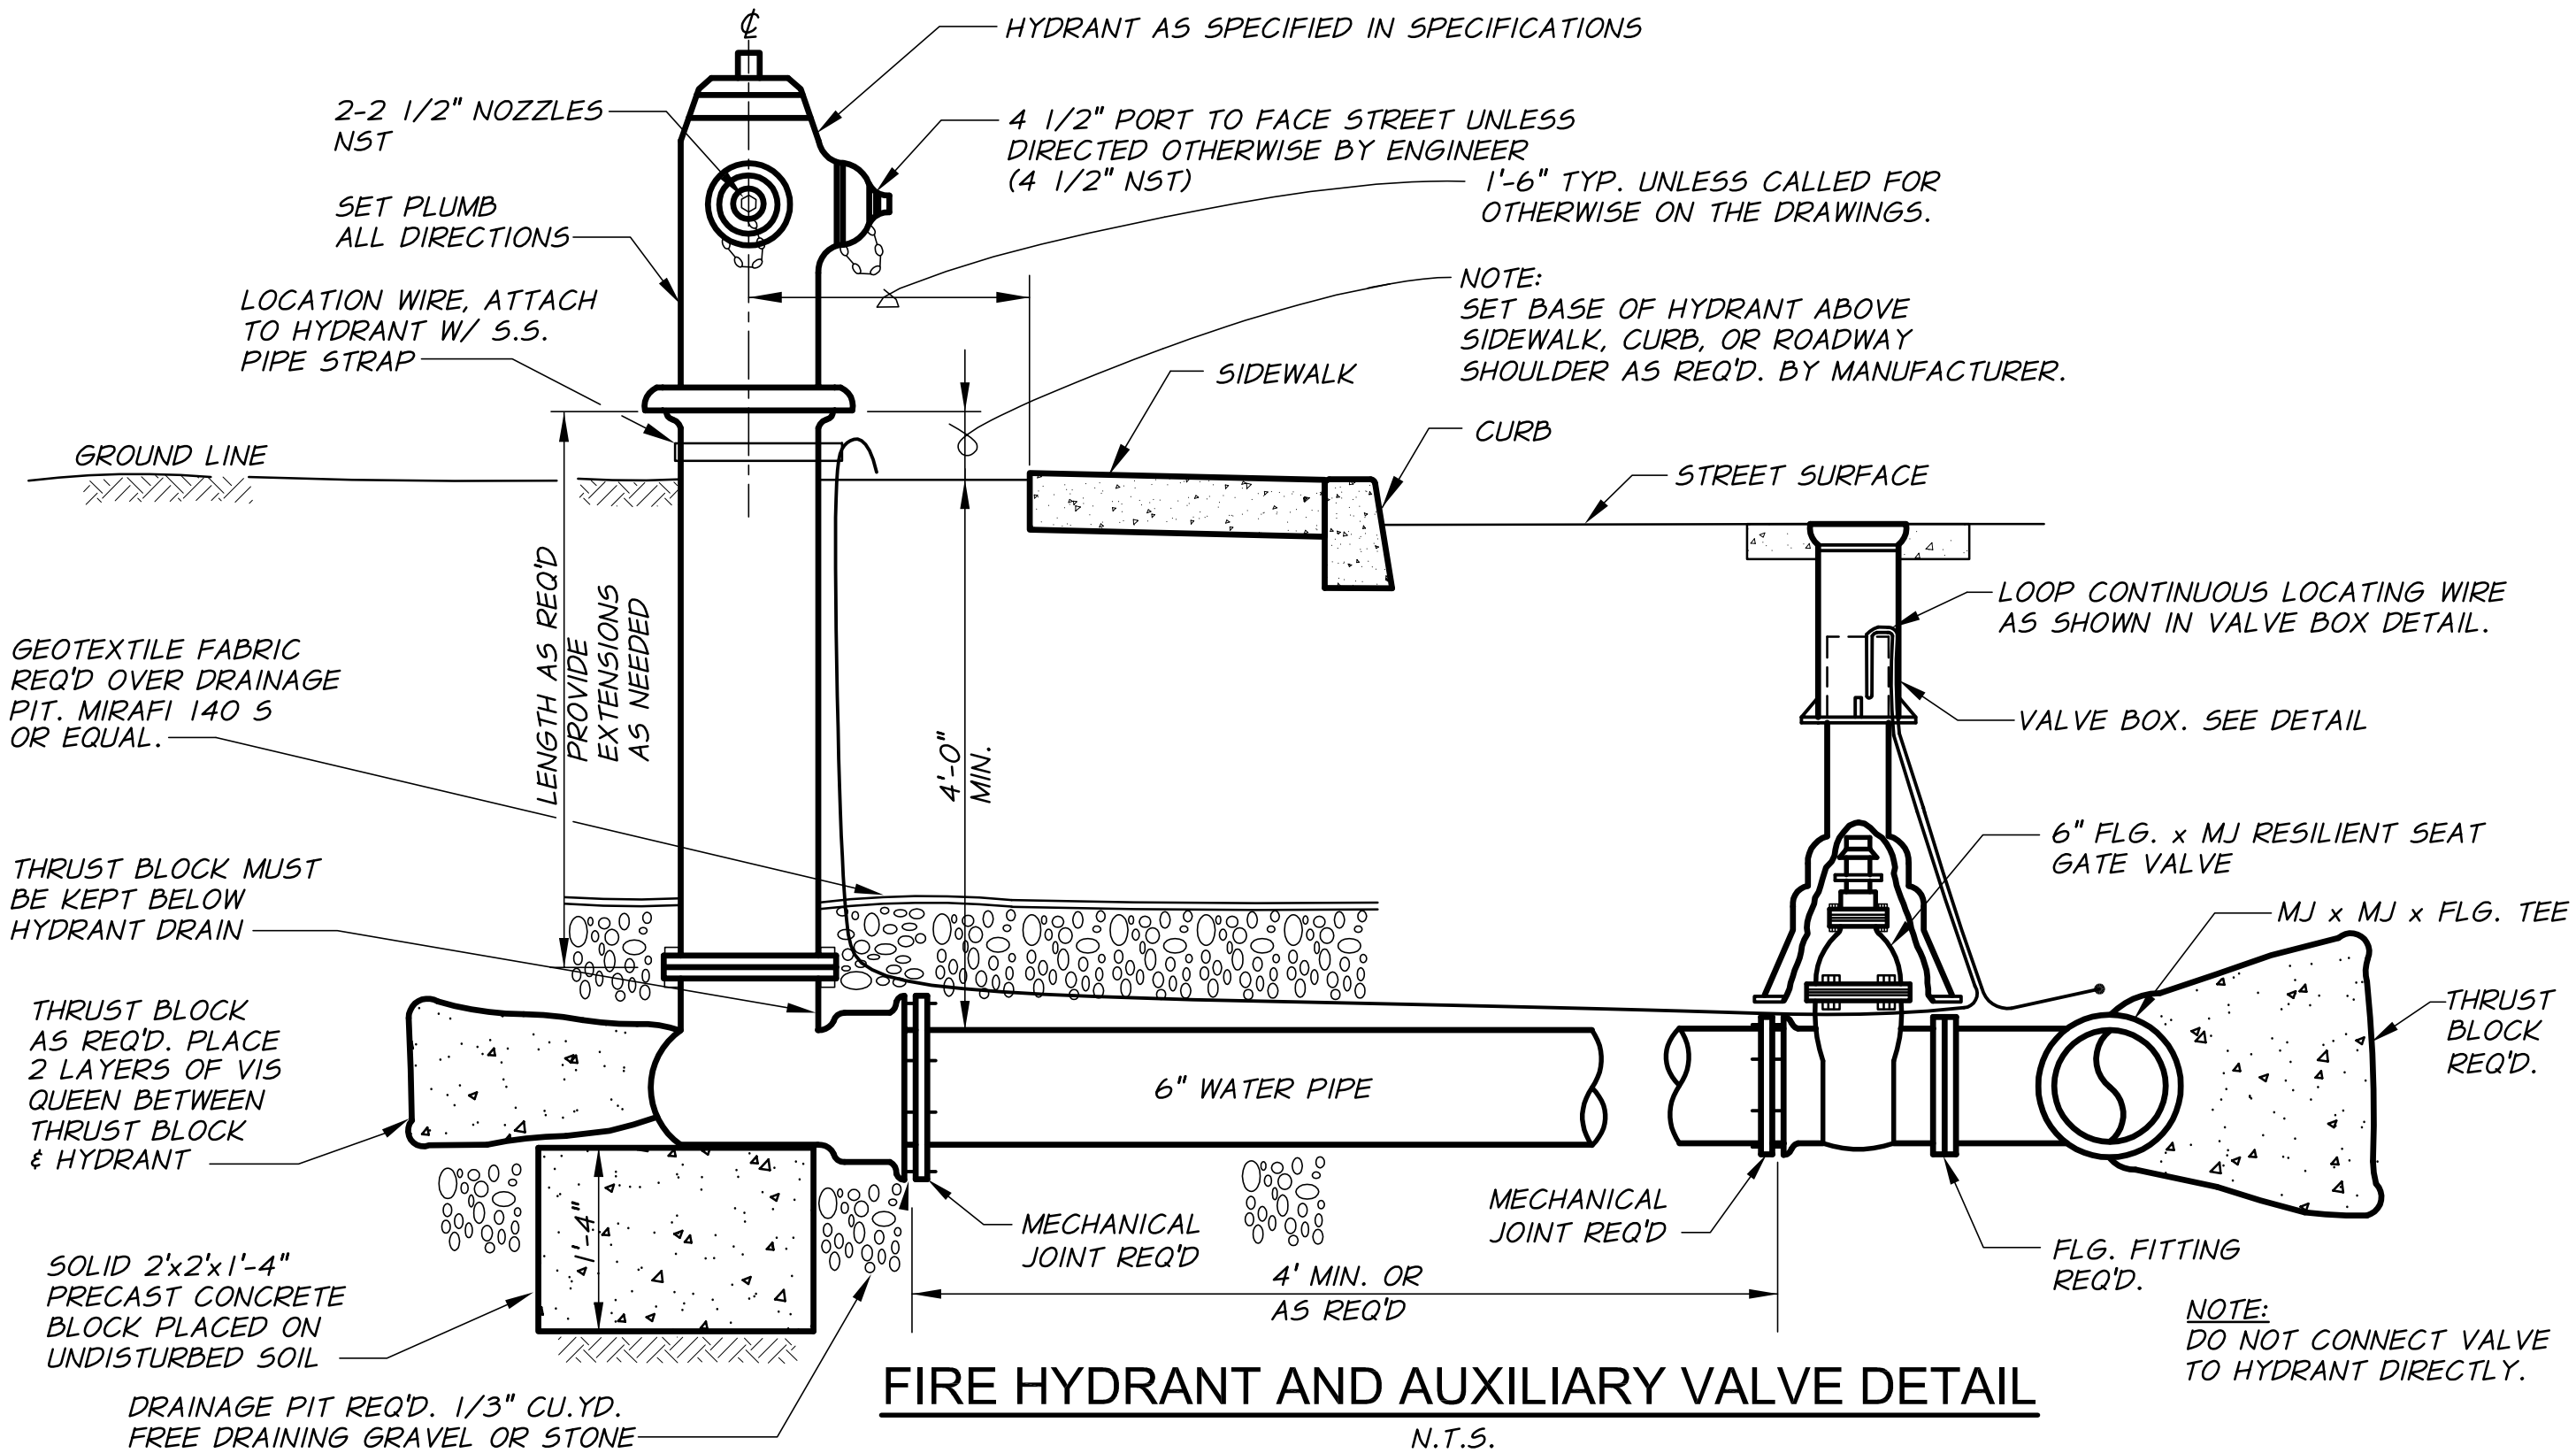

NOTE:
DO NOT CONNECT VALVE TO HYDRANT DIRECTLY.

FIRE HYDRANT AND AUXILIARY VALVE DETAIL

N.T.S.

REVISION	DATE
GENERAL UPDATES	12/06

CITY OF UNION OREGON

STANDARD WATER DETAILS
FIRE HYDRANT AND AUXILIARY VALVE DETAIL

FIGURE
W7

S:\UNION\Stddwg\Water\W3_1.dwg, Layout1, 1/2/2007 10:20:29 AM, earntz