


- NOTES:**
1. 4" DIA. STEEL PIPE SHALL BE PLUMB.
 2. LOCATE PIPES EQUIDISTANT FROM FIRE HYDRANT.
 3. PAINTING SHALL BE DONE ONLY AFTER SURFACE IS FREE OF RUST, OIL, AND GREASE. THE METAL SHALL BE PRIMED AND TWO FINISH COATS, YELLOW IN COLOR APPLIED.

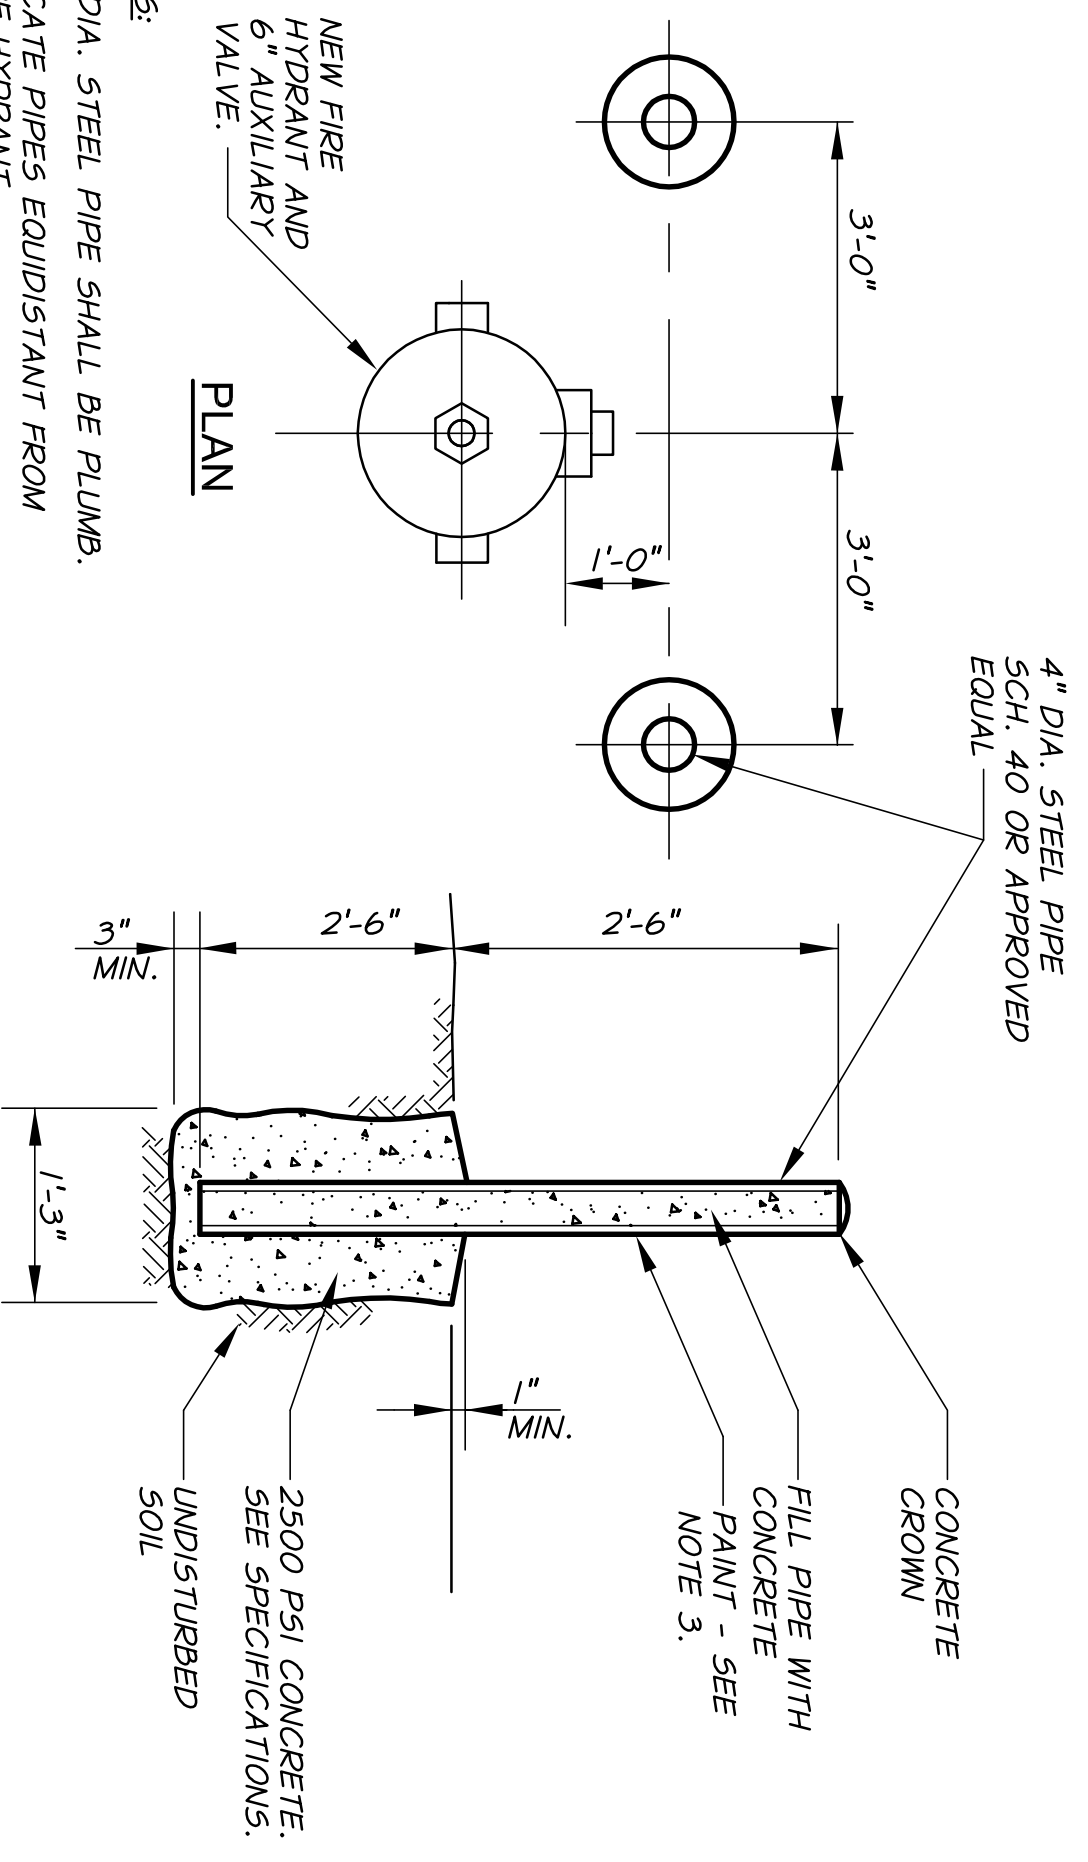

FIRE HYDRANT BARRICADE

N.T.S.

REVISION	DATE	CITY OF UNION OREGON	STANDARD WATER DETAILS FIRE HYDRANT BARRICADE	FIGURE W8